

СЕТЬ




A



kW·h

0 5 2 7 2 1



ЦЭ6803В

ЭНЕ

3x220/380V

10-100A

50Hz

A=400 imp/kW·h

ГОСТ 30207-94



№ 3060996

ME 48

2003 г.

2



КАНІІ ПАІНІІ
ВНІМАННІЕІ
ОДЛОМБІРОВАНО


ІНДІКАТОР ВОЗДЕІСТВІЯ
МАГНІТНОГО ПОЛЯ

КЭ 010







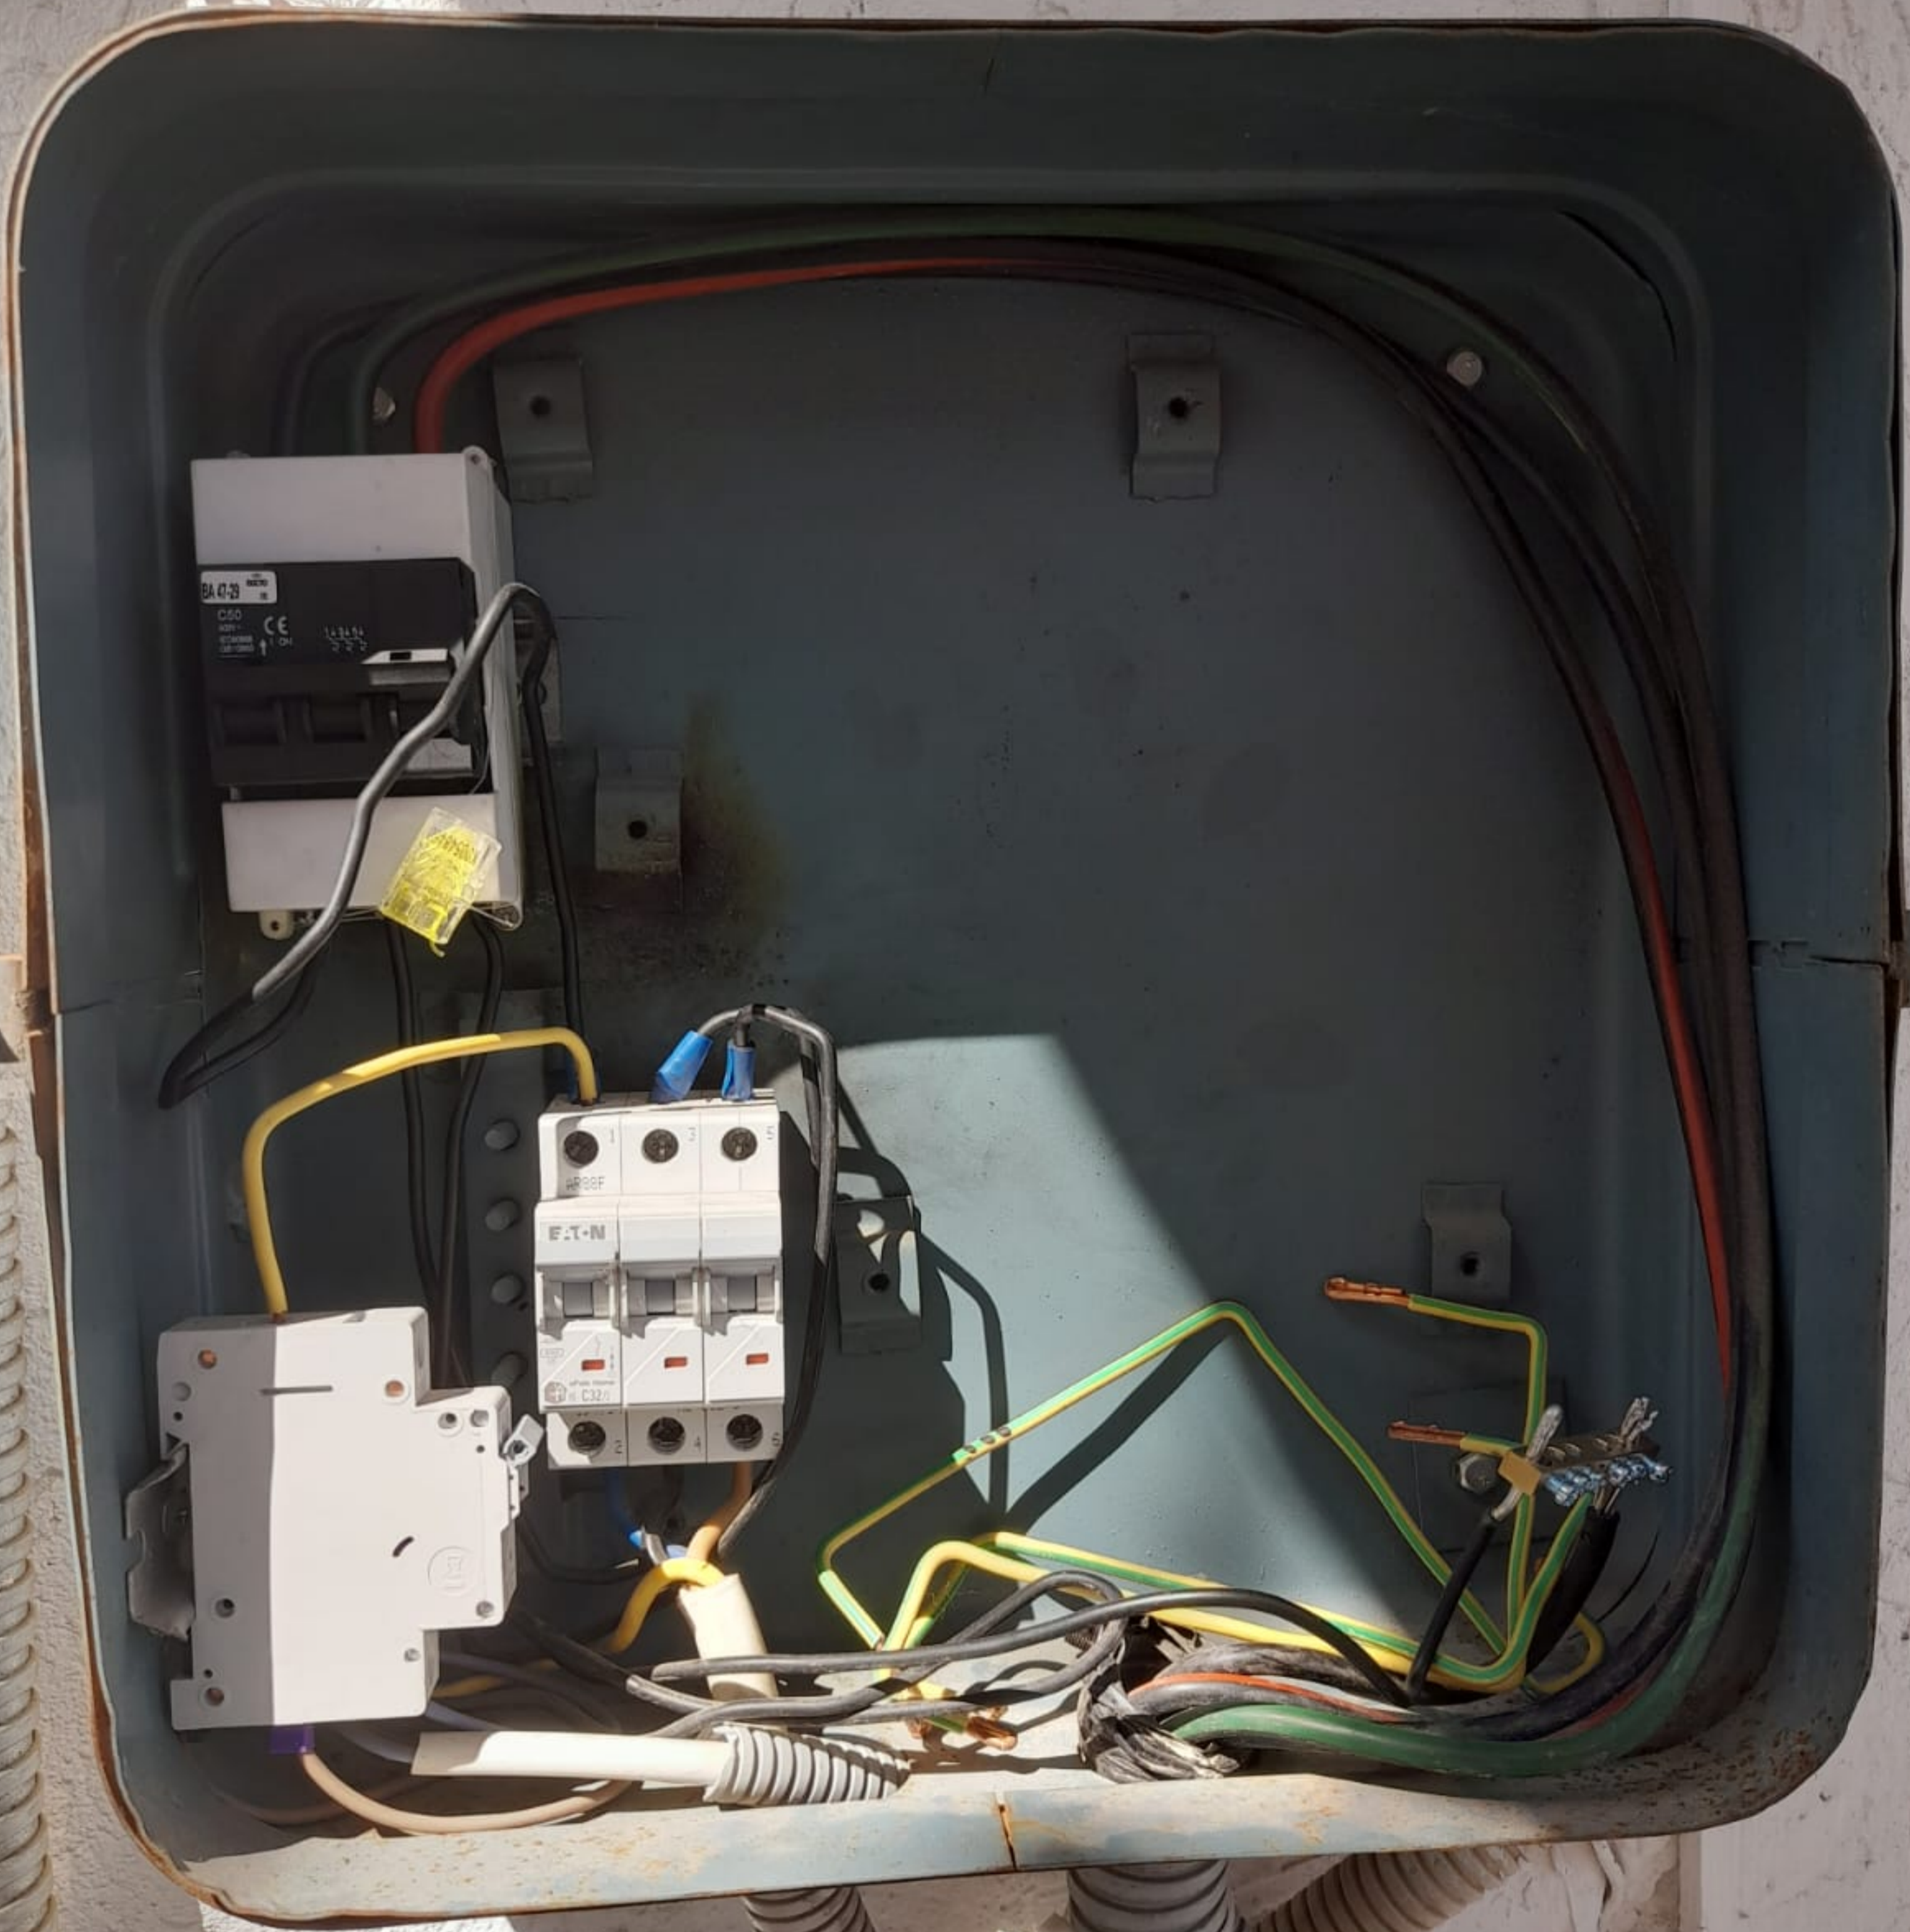

BA 0-8

C50

E.T.N.

C32

PROF

E.T.N.

C32